

# STORAGE TANKS

VALVE MARKINGS

ORANGE LIQUID

NF-110

WITHIN 12" OF VALVES

YELLOW VAPOR

NF-111

WITHIN 12" OF VALVES


DEALERS NAME,  
ADDRESS, AND  
PHONE NUMBER

**ABC**  
FERTILIZER  
WINSLOW, NEBR  
402/664-3025  
EMERGENCY  
402/602-2111  
FIRE DEPT. 911



NF-CA -- C-6

DISPLAYED ON OR AT TANK AREA

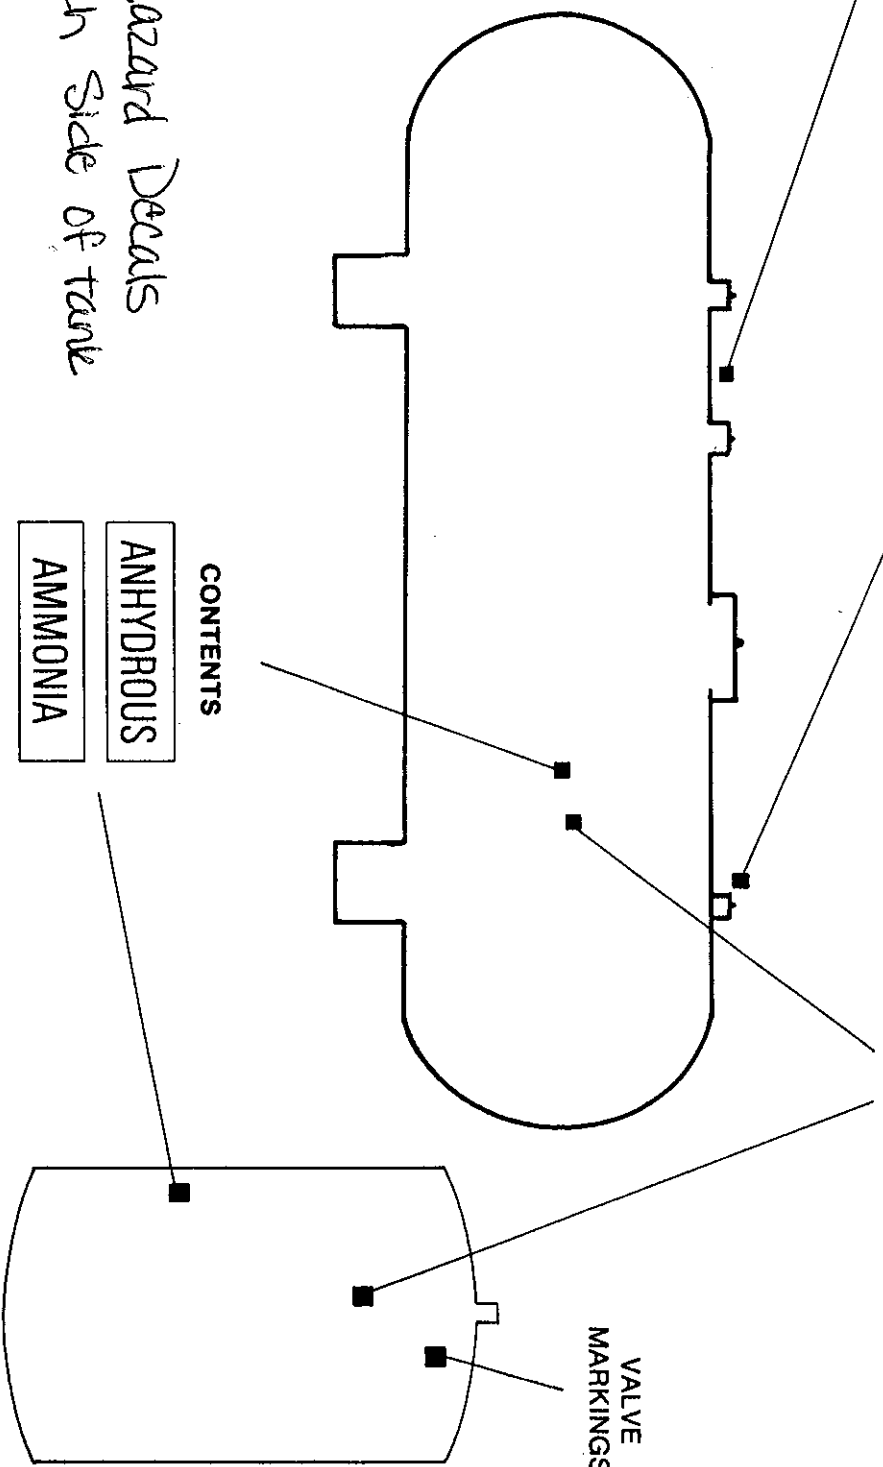

CONTENTS  
ANHYDROUS  
AMMONIA

NF-101

DISPLAYED ON TANK

VALVE MARKINGS

2 Inhalation Hazard Decals  
1 Need on each Side of tank


# NURSE TANK

500 GAL. OR MORE

## VALVE MARKINGS

*2 NF-121 (Inhalation Hazard) Placard (1 on each side)*

## SLOW SIGN



**NF-106**  
BACK OF TANK

Dealer Name and Address (optional)

LIQUID LIQUID VAPOR RELIEF LIQUID VAPOR  
FIXED LIQUID LEVEL GAGE

## (DISPLAYED ON VALVES)


**NF-108**

\* A readily available container of not less than 5 gallons of clear water

## PLACARD




**NF-103**  
ALL FOUR SIDES  
Both ends and both sides



## REFLECTOR

**NF-107**  
AXLE RAILS  
EMERGENCY/SAFETY  
RELIEF VALVE INDICATOR

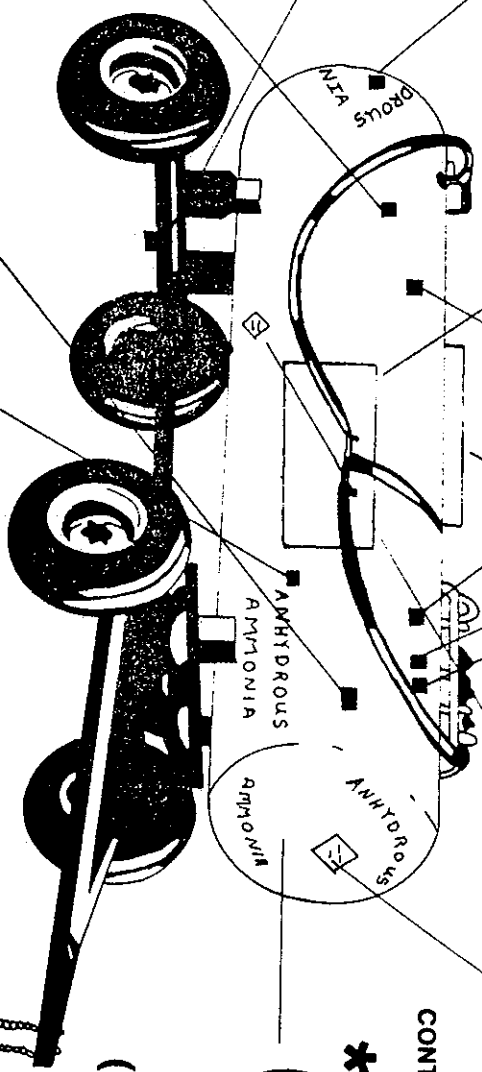

## CONTENTS CIRCULAR MARKING



**NF-101**

## (ENDS OF TANK)


\* Safety chain or cable of not less than 3/8 inches

Transfer Instructions

(Ahead or Below Park Plug) Coupling connect transfer required on nurse tanks.


## CONTENTS; RECTANGULAR MARKINGS

ANHYDROUS AMMONIA

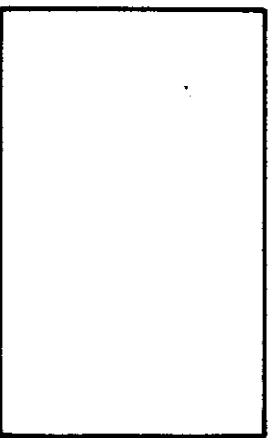

**NF-112**

(NEXT TO SAFETY VALVE)



## SAFETY VALVE

**NF-102**

## (SIDES OF TANK)

At least 2 inch high letters

\* Required by State Fire Marshal's Office

○ Required by trailers exceeding 80 in.