

# STORAGE TANKS

VALVE MARKINGS

ORANGE LIQUID

NF-110

WITHIN 12" OF VALVES

YELLOW VAPOR

NF-111

WITHIN 12" OF VALVES


DEALERS NAME,  
ADDRESS, AND  
PHONE NUMBER

**ABC**  
FERTILIZER  
WINSLOW, NEBR  
402/664-3025  
EMERGENCY  
402/602-2111  
FIRE DEPT. 911



NF-CA -- C-6

DISPLAYED ON OR AT TANK AREA

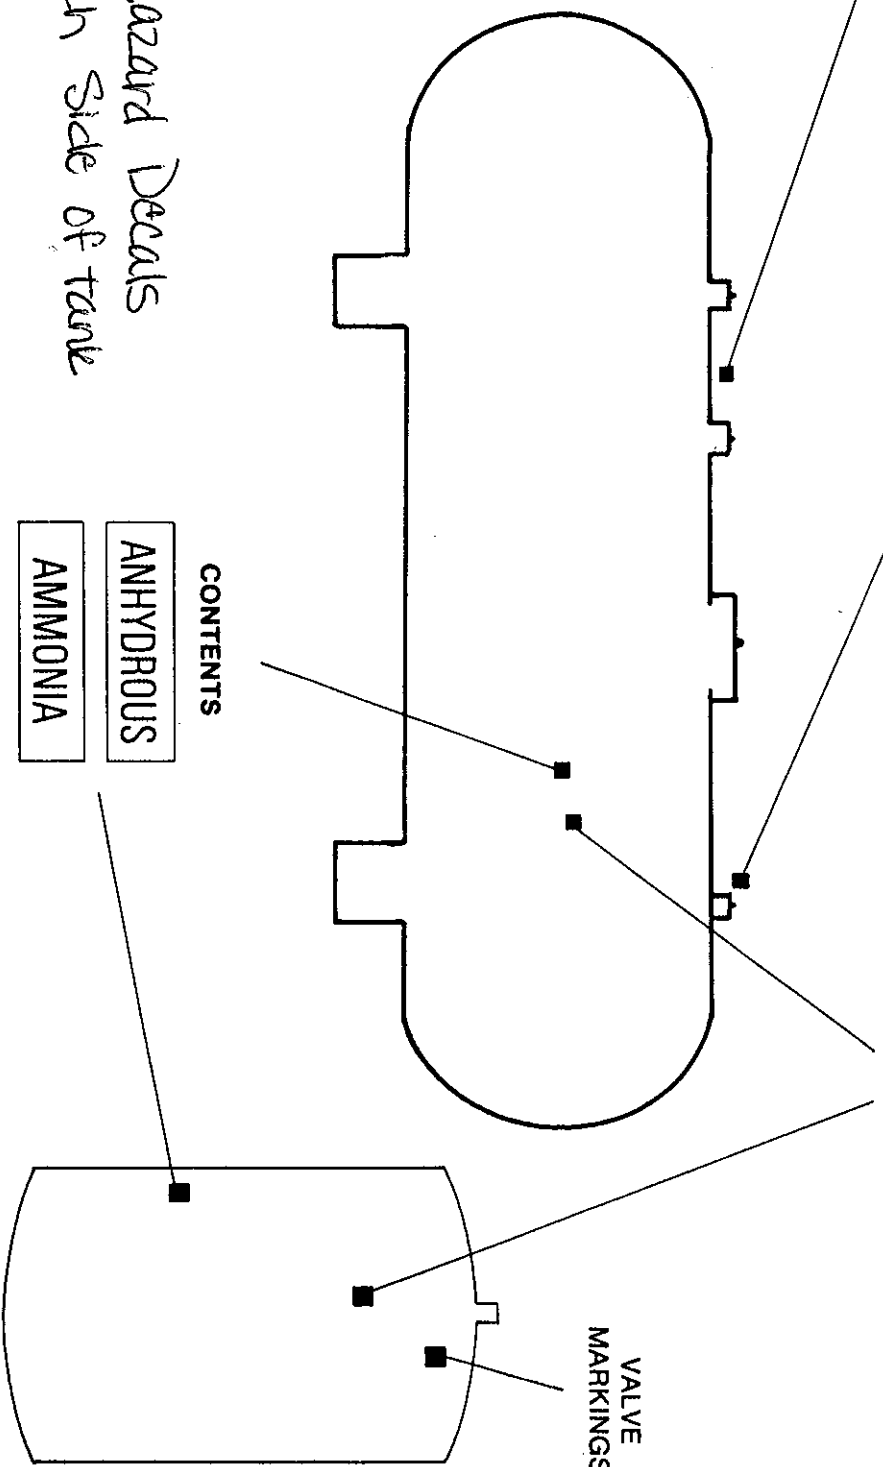

2 Inhalation Hazard Decals  
1 Need on each Side of tank

CONTENTS  
ANHYDROUS  
AMMONIA

NF-101

DISPLAYED ON TANK

VALVE MARKINGS


# NURSE TANK

500 GAL. OR MORE

## VALVE MARKINGS

*2 NF-121 (Inhalation Hazard) Placard (1 on each side)*

## SLOW SIGN



NF-106  
BACK OF TANK

Dealer Name  
and  
Address  
  
(optional)

LIQUID  
... LIQUID  
VAPOR  
... RELIEF  
LIQUID  
VAPOR  
FIXED LIQUID  
LEVEL GAGE

## (DISPLAYED ON VALVES)


NF-108

\* A readily available container of not less than 5 gallons of clear water

## PLACARD



NF-103  
ALL FOUR SIDES  
Both ends and both sides




NF-107  
REFLECTOR

AXLE RAILS  
EMERGENCY/SAFETY  
RELIEF VALVE INDICATOR



NF-112

(NEXT TO SAFETY VALVE)

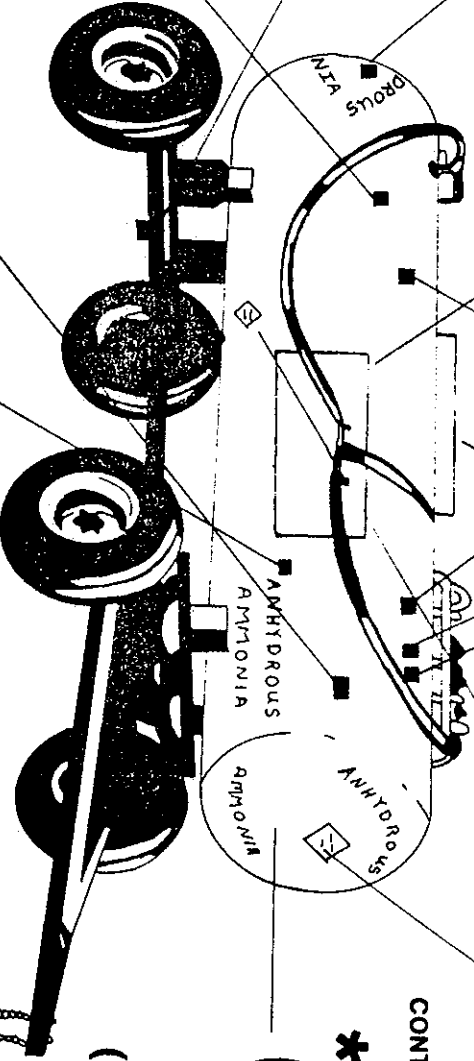

Transfer Instructions  
  
(Ahead or Below Park Plug) Coupling connect transfer required on nurse tanks.

## CONTENTS; RECTANGULAR MARKINGS

ANHYDROUS AMMONIA

NF-102  
(SIDES OF TANK)  
At least 2 inch high letters

Safety chain or cable of not less than 3/8 inches

CONTENTS CIRCULAR MARKING  
ANHYDROUS AMMONIA

NF-101

(ENDS OF TANK)

\* Required by State Fire Marshal's Office

○ Required by trailers exceeding 80 in.